City of Riverside


Building & Safety Division

去


DISABLED ACCESS STANDARDS

1998 CALIFORNIA BUILDING CODE. PART 2 OF TITLE 24
OF THE CALIFORNIA CODE OF REGULATIONS












THE DIAGRAMS, DIMENSIONS & TABLES CONTAINED HEREIN ILLUSTRATE THE SPECIFIC REQUIREMENTS
OF THESE REGULATIONS AND ARE INTENDED ONLY AS AN AID FOR BUILDING DESIGN AND CONSTRUCTION

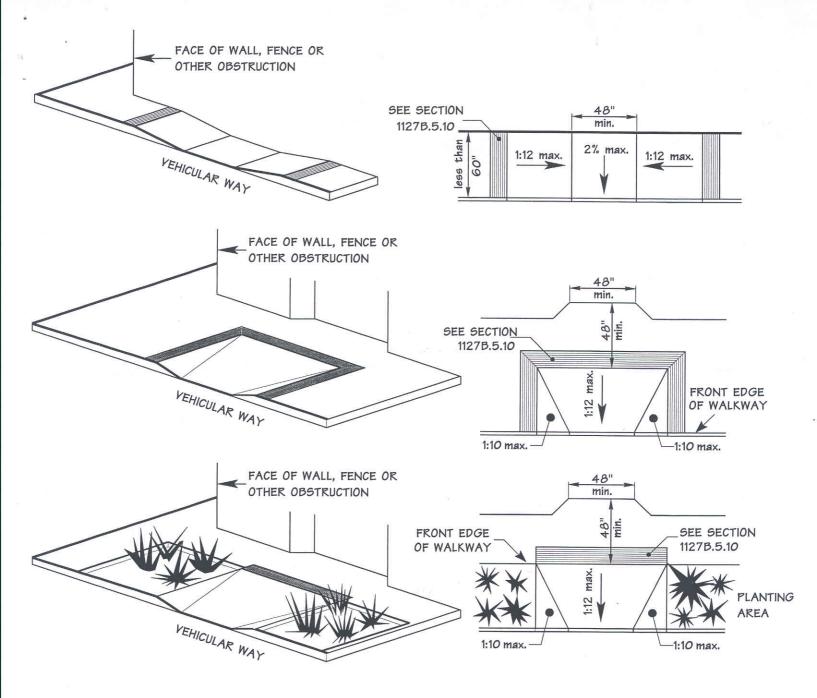


CURB RAMPS

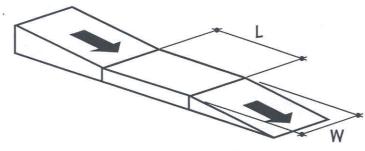


STRAIGHT RUN

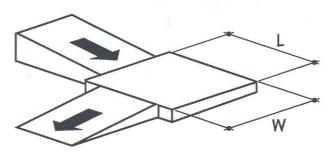

90 DEGREE TURN

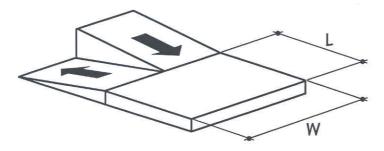

180 DEGREE TURN

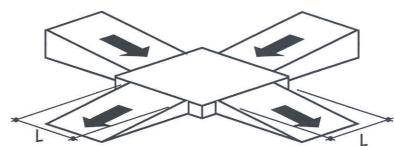


INTERSECTING RAMPS

INTERMEDIATE	LANDINGS	@ RAMPS	
RAMP CONFIGURATION	LENGTH (L)	WIDTH (W)	NOTES
STRAIGHT RUN	5'-0" min.	4'-0" min.	1, 2, 3, 4
90 DEGREE TURN	6'-0" min.	5'-0" min.	1, 2, 3
180 DEGREE TURN	6'-0" min.	8'-0" min.	1, 2, 3
INTERSECTING RAMPS	6'-0" min.		1, 2, 3

NOTES:

- 1 Handrails & Guardrails have been omitted for clarity.
- 2 Landings in exterior locations may have up to a 1/4-inch per foot slope in either direction.
- 3 For doors opening onto landings, refer to sheet ??.
- 4 A change of direction not exceeding 30 degrees is considered a Straight Run

LANDINGS AT RAMPS

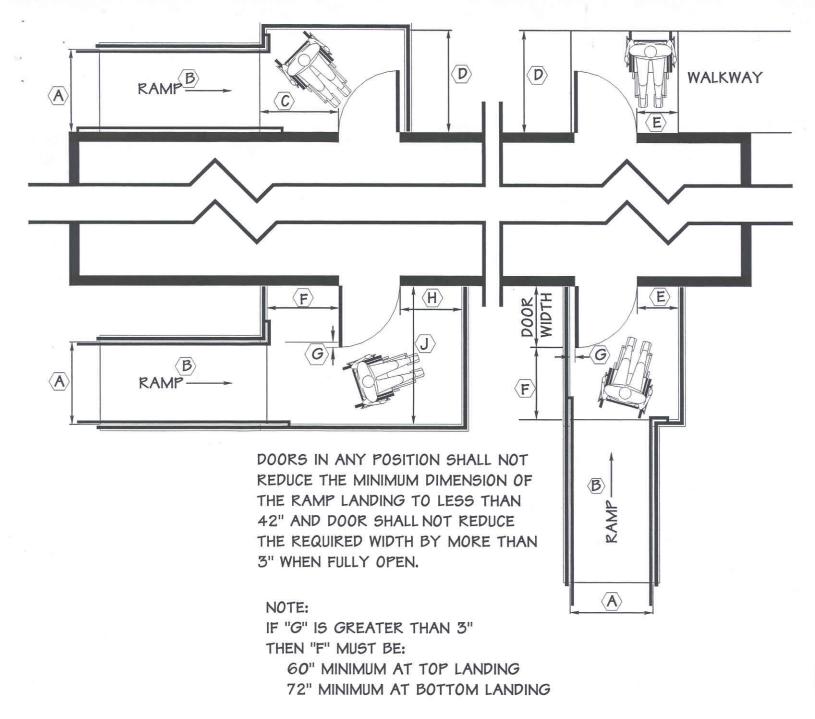

LEGEND ()

A: 48" MINIMUM

B: MAX. SLOPE: 1:12

C: 42" MINIMUM

D: 60" MINIMUM

E: 24" MINIMUM


F: 42" MINIMUM


G: 3" MAXIMUM


H: 36" MINIMUM


J: 60" MINIMUM

ENCROACHMENT OF DOORS ONTO LANDINGS

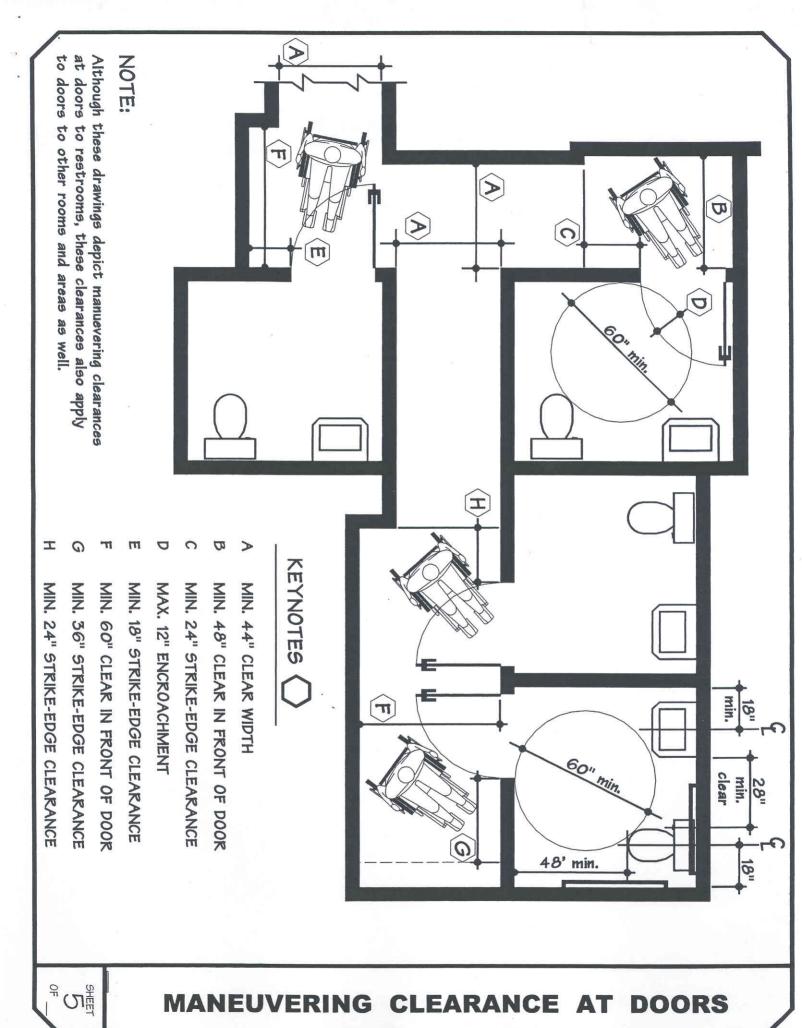

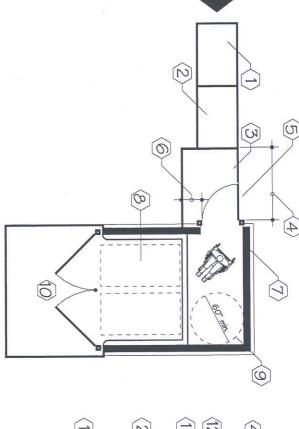



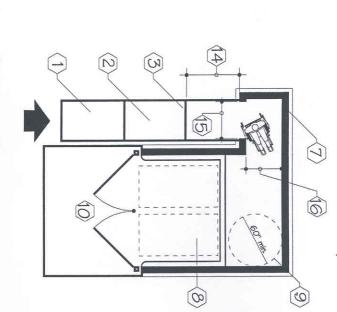

ACCESSIBLE TRASH ENCLOSURES

KEYNOTES ()

- I LANDING @ LOWER LEVEL (MIN. 6'-0" L.)
- 2 MIN. 48" WIDE RAMP @ MAX. 1:12 (8.33%) SLOPE
- 3 LANDING @ UPPER LEYEL (MIN. 5'-0" L.)
- 4 GATE WIDTH + 42" MIN.
- 5 GATE (MIN. 3'-0" WIDTH)
- 6 MIN. 2'-0" STRIKE-EDGE CLEARANCE
- 7 TRASH ENCLOSURE WALLS
- 3 TRASH BINS

- 9 WHEELCHAIR TURNING CIRCLE (MIN. 60" DIA.)
- 10 TRASH ENCLOSURE GATES

MIN. 42" STRIKE-EDGE CLEARANCE

- 12 LEVEL LANDING
- 13 MIN. 5'-0"
- 14 MIN. 5'-0"
- 15 MIN. 42" CLEAR
- 16 MIN. 48" CLEAR

